

Classification report

Sound reduction of building elements

Test report 161 25651/3.0.0e^{*)}



Customer **ELVIAL S.A.**
Aluminium Extrusion
26th km national road

61100 Thessaloniki-Kilkis

Foundation


EN 20140-3 : 1995-01
Laboratory measurements of
airborne sound insulation of
building elements

EN ISO 717-1 : 1996-12
Acoustics – Rating of sound in-
sulation in buildings and of
building elements - Part 1: Air-
borne sound reduction

Similar to DIN EN 20140-3 and
DIN EN ISO 717-1

Specimen	Single-Window
System designation	el-2000 Benefit
Size (W x H)	800 mm x 1000 mm
Material	Aluminium profile
Opening	Turn
Glazing	5/12/4 mm
Specials	*) This test report is a translation of test report no. 161 25651/3.0.0 of 23 September 2002

Cross-section



Purpose

This test report prove the sound reduction for a building element.

Validity

The values given in this test report are only valid for the tested specimen described.

General conclusions for the construction and other functional details may not be drawn from this test report.

Information for use

Regulations for the use of test reports are given in the enclosed information sheet „Conditions and information for use of ift test reports for publication and commercial purposes“.


This report is a translation of the test report 161 25651/3.0.0 of 23. September 2002.

Weighted sound reduction index R_w
Spektrum-Adaption terms C and C_{tr}



$$R_w (C; C_{tr}) = 36 (-2;-6) \text{ dB}$$

ift Rosenheim
23. September 2002

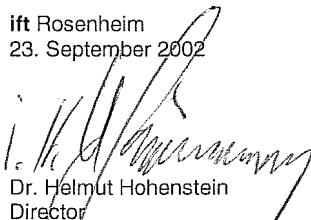
Dr. Helmut Hohenstein
Director

Institut für Fenstertechnik e.V.
Leiter: Dr. Helmut Hohenstein
ift Rosenheim, Zertifizierungsstelle
Leiter: Dipl.-Ing. (FH) Ulrich Sieberath
02-08 / 353

Theodor-Gietl-Str. 7-9
83026 Rosenheim
Tel. +49 (0) 8031 261-0
Fax +49 (0) 8031 261-290
<http://www.ift-rosenheim.de>


i. A. Bernd Saß
Leader of acoustic laboratory

Sparkasse Rosenheim
Kto. 38 22, BLZ 711 500 00
IBAN DE90 7115 0000 0000 0038 22
Postbank München
Kto. 2549 26-801, BLZ 700 100 80

Contents

This test report includes 6 pages

- 1 Test specimen
 - 2 Test procedure
 - 3 Test results
- Data sheet (1 page)



DAP-PL-0808.01
DAP-ZE-2288.00
TGA-ZM-16-93-00
TGA-ZM-16-93-60